USE COPPER CONDUCTORS ONLY

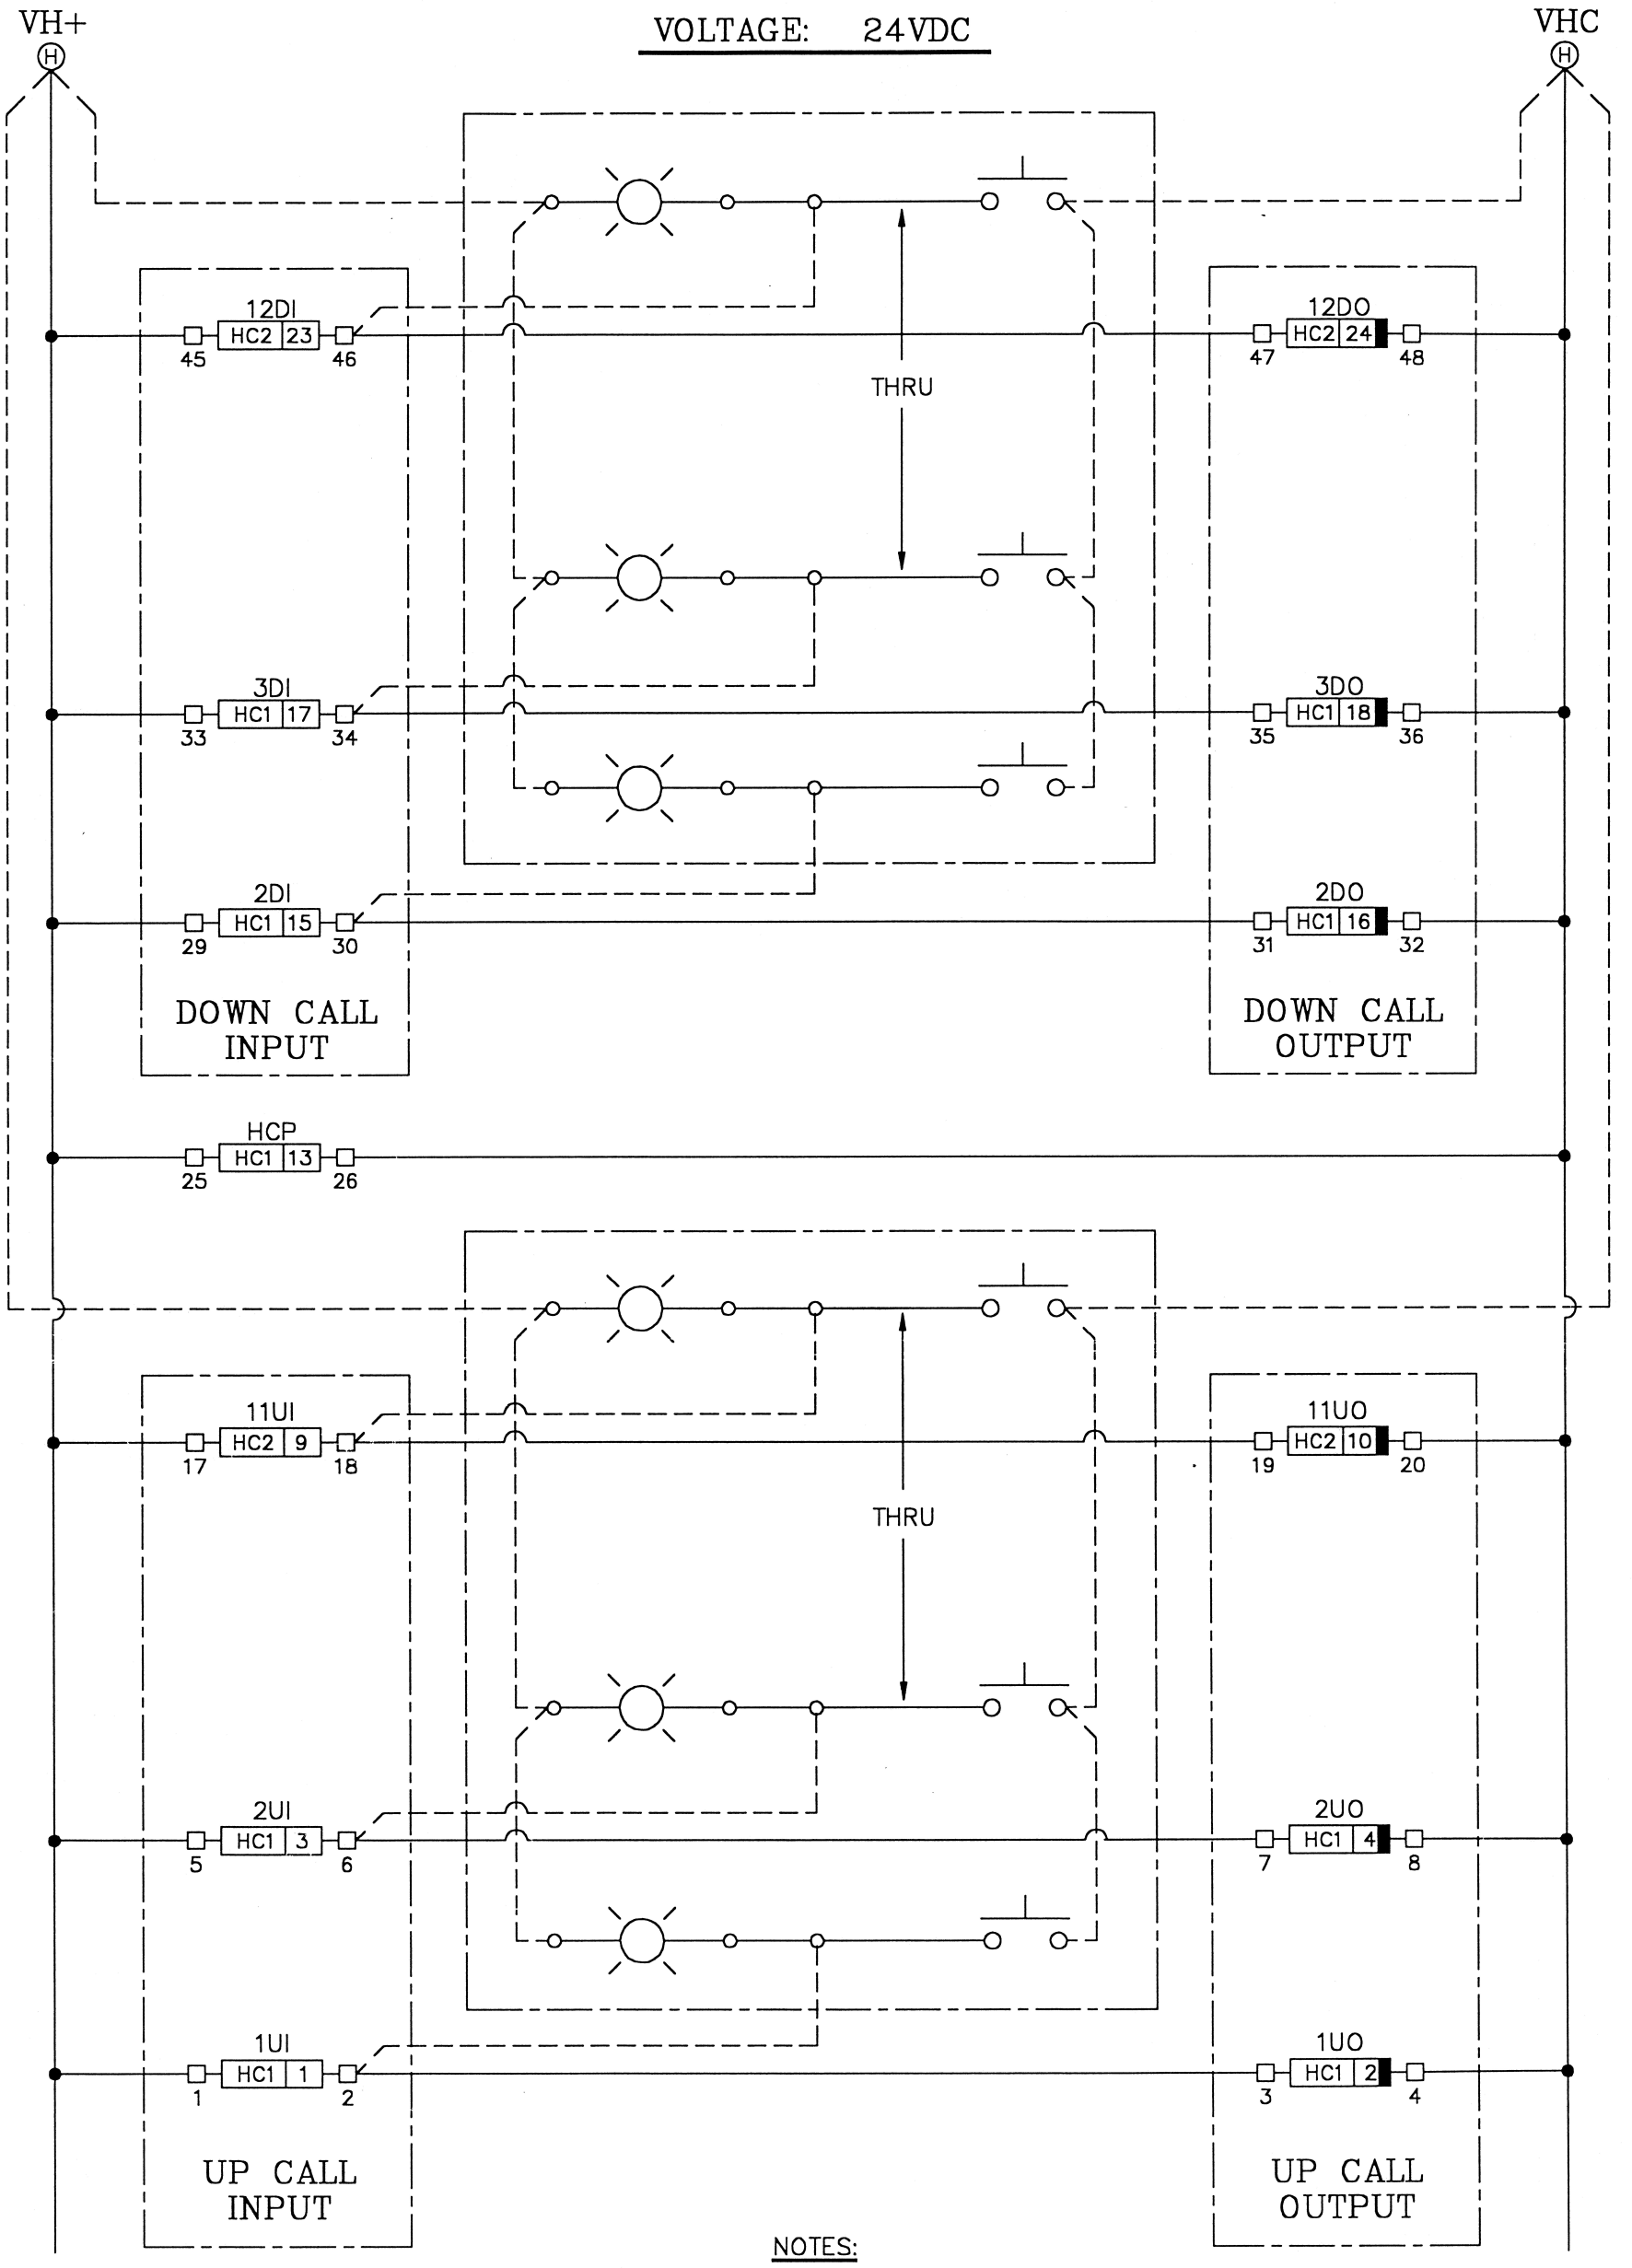

NOTES:

HC BOARDS LOCATED ON REMOTE GROUP

FOR MODULE LOCATION AND FLOOR LAYOUT REFER TO SMI (HC1–HC6 BOARDS)

HC1 FOR 1–6 LANDINGS HC3 FOR 13–18 LANDINGS HC5 FOR 25–30 LANDINGS

HC2 FOR 7–12 LANDINGS HC4 FOR 19–24 LANDINGS HC6 FOR 31–36 LANDINGS

24VDC HALL CALL–SMI BOARD INTERFACE

DRAWING NUM 154

COMPUTERIZED ELEVATOR CONTROL CORP.
636 11TH AVENUE NEW YORK, NEW YORK 10036 TEL. (212) 397–0606

JOB NAME/LOC.: EMBASSY SQUARE SUITES WA, DC (AMTECH)		
DATE: 04/12/96	CEC JOB NO. 2989	CAR NO. 1 THRU 4
DRAWN BY: NF	DWG. NO. 154HCSMI	REV. 12–20–94

04/12/96 11:13 E:\JOBS\2900\2989\154HCSMI.DWG