


USE COPPER CONDUCTORS ONLY

VOLTAGE: 24 VDC

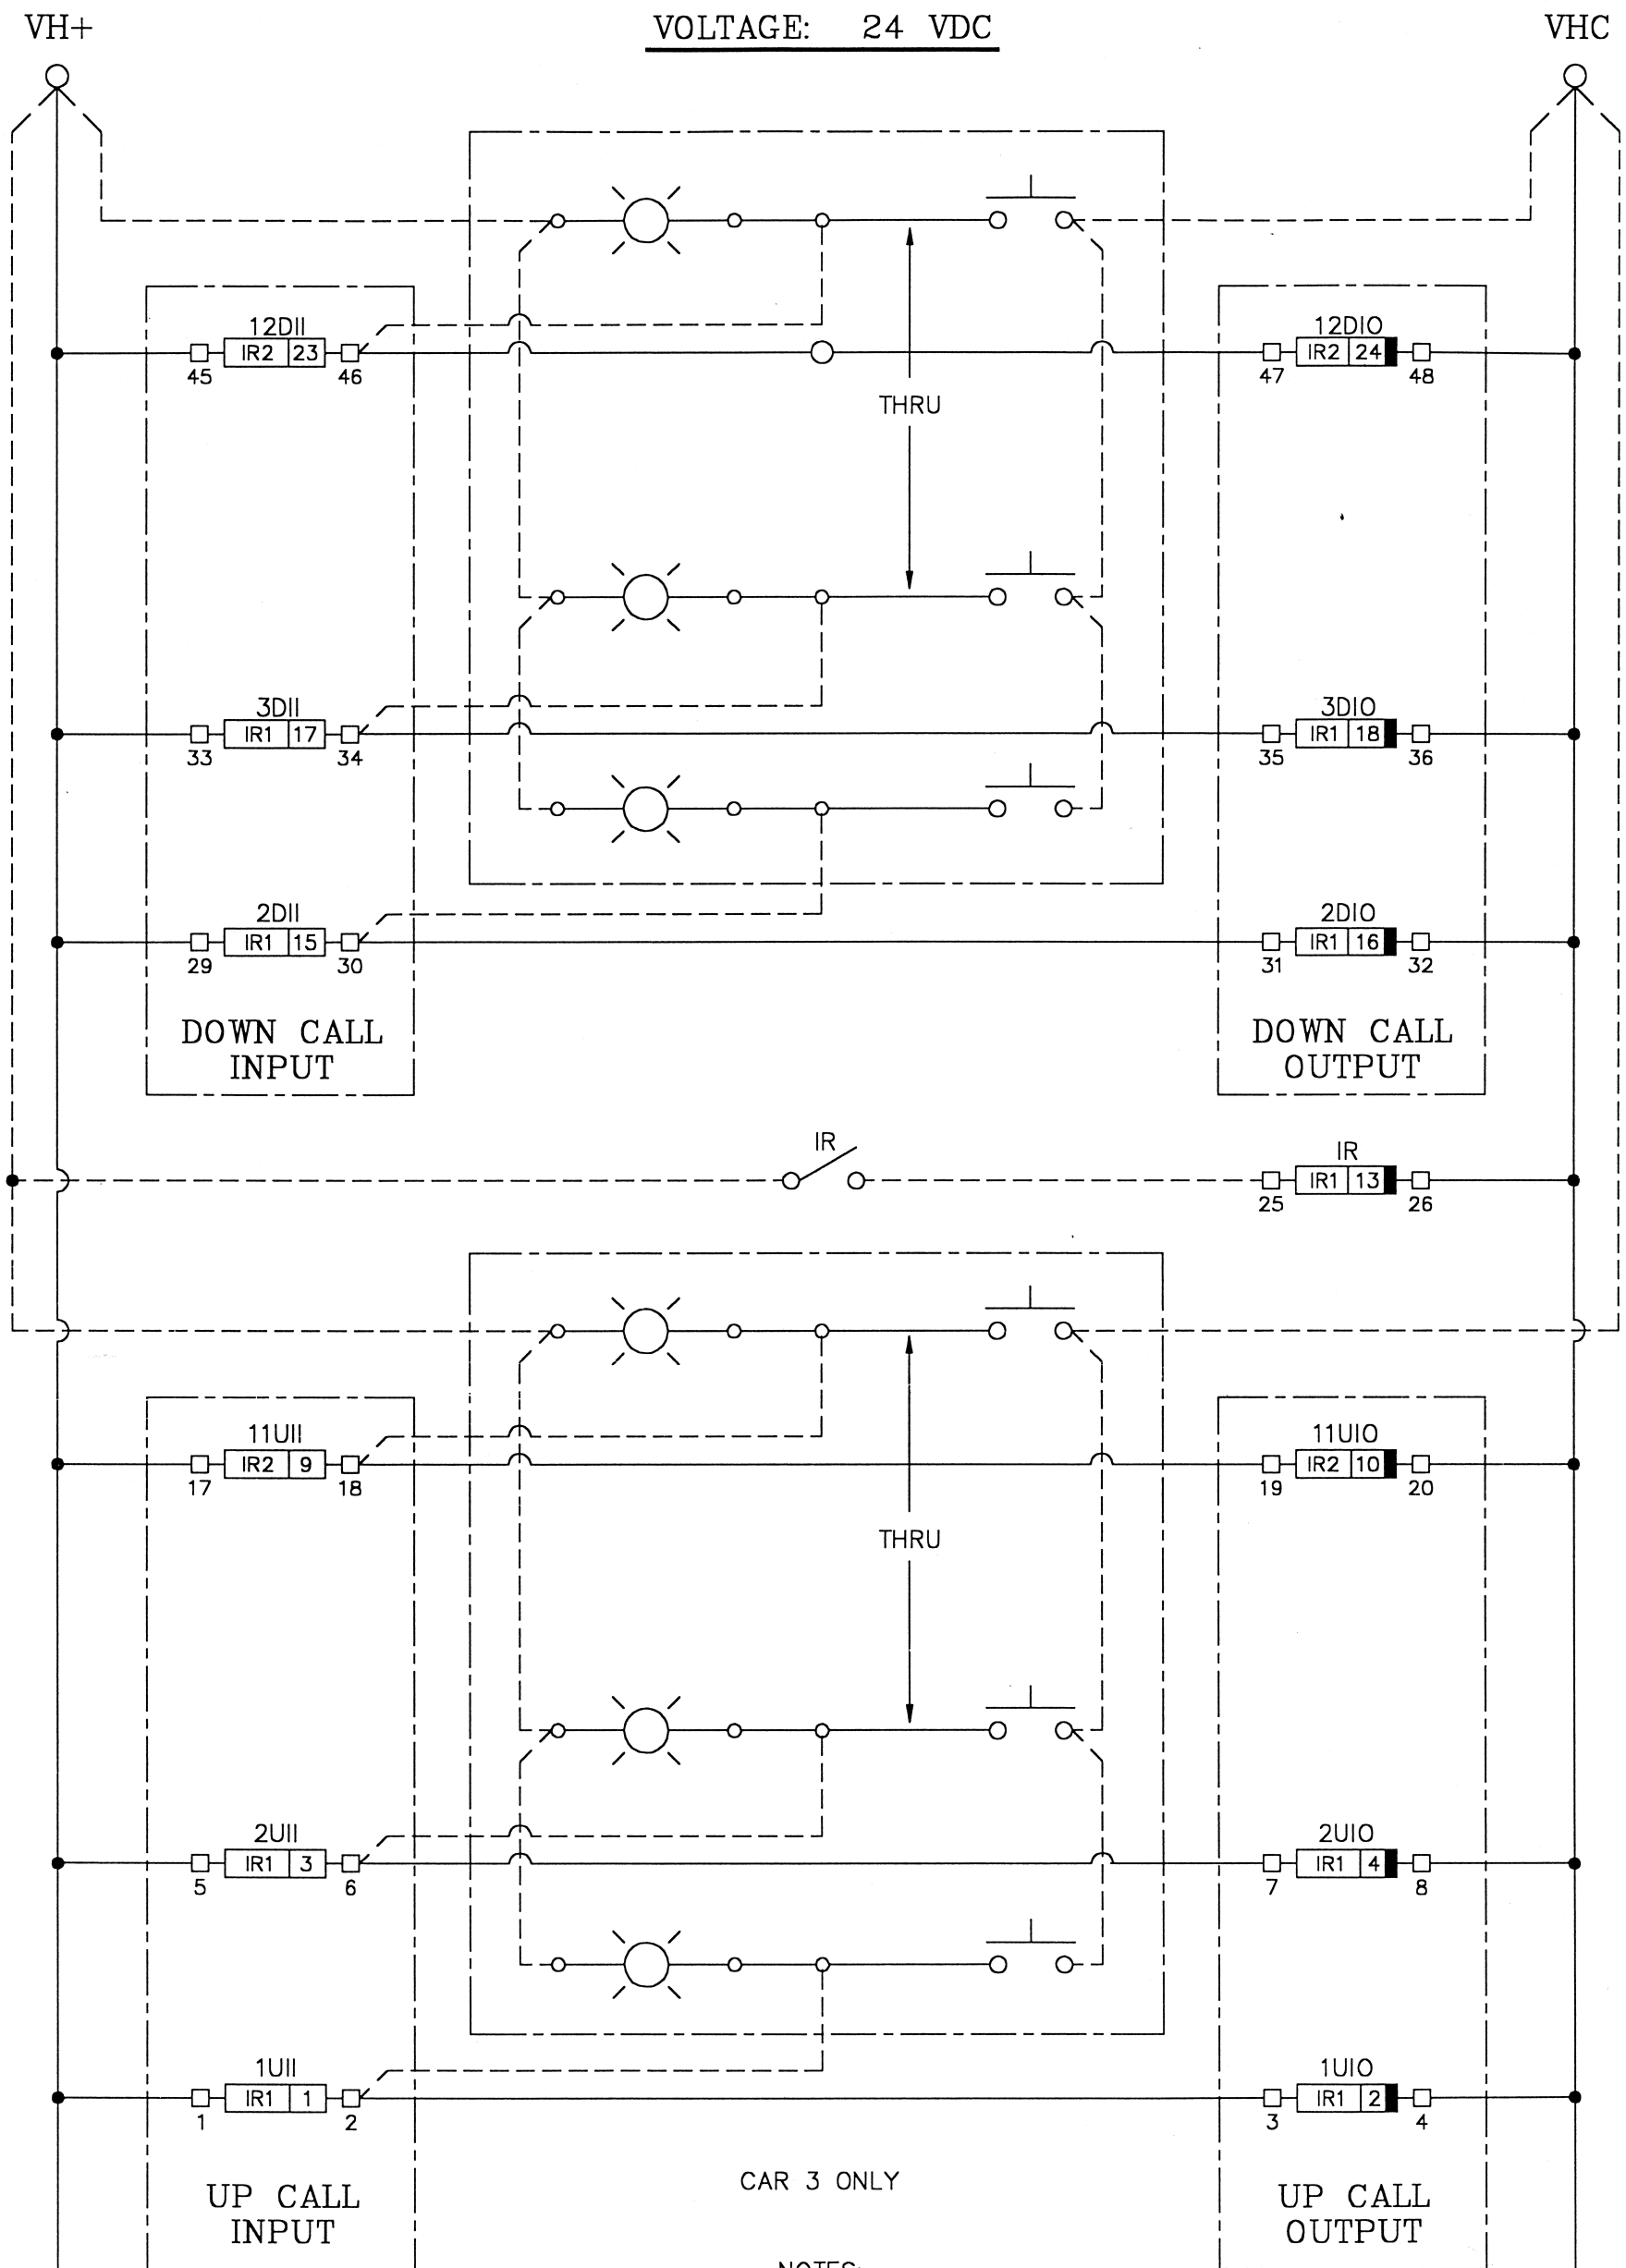

NOTES:

IR BOARDS LOCATED ON REMOTE GROUP

FOR MODULE LOCATION AND FLOOR LAYOUT REFER TO SMI (IR1-IR3 BOARDS)

IR1 FOR 1-6 LANDINGS	IR3 FOR 13-18 LANDINGS
IR2 FOR 7-12 LANDINGS	IR4 FOR 19-24 LANDINGS

24VDC IR CALL-SMI BOARD INTERFACE

DRAWING NUM
155

COMPUTERIZED ELEVATOR CONTROL CORP.

636 11TH AVENUE NEW YORK, NEW YORK 10036 TEL. (212) 397-0606

JOB NAME/LOC.: EMBASSY SQUARE SUITES WA, DC (AMTECH)

DATE: 04/12/96	CEC JOB NO. 2989	CAR NO. 3
----------------	------------------	-----------

DRAWN BY: NF	DWG. NO. 155IRHC	REV. 3-15-95
--------------	------------------	--------------

04/12/96 11:05 E:\JOBS\2900\2989\155IRHC.DWG