


USE COPPER CONDUCTORS ONLY

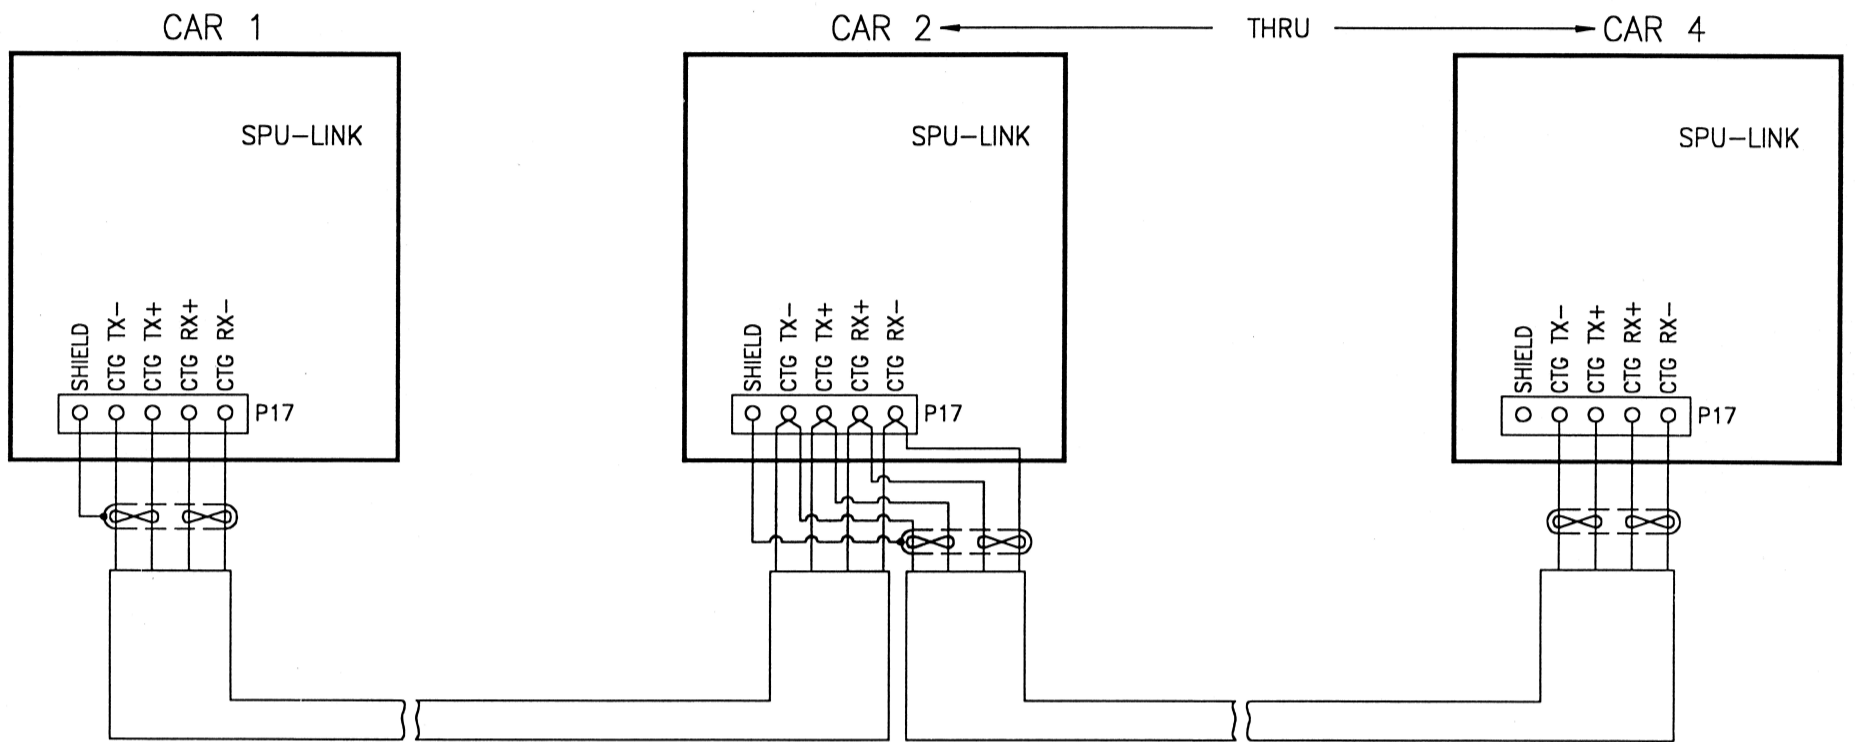

CONNECTION TABLE

CAR 1	CAR 2	CAR 4
CTG TX--→	CTG TX--→	CTG TX--→
CTG TX+→	CTG TX+→	CTG TX+→
CTG RX+→	CTG RX+→	CTG RX+→
CTG RX--→	CTG RX--→	CTG RX--→

NOTE: SHIELD IS CONNECTED ON CABLE LEAVING CONTROLLER ONLY.
SHIELD ON CABLE ENTERING CONTROLLER IS CUT AND LEFT UNCONNECTED.

CAR TO GROUP COMM

DRAWING NUM
190

COMPUTERIZED ELEVATOR CONTROL CORP.
636 11TH AVENUE NEW YORK, NEW YORK 10036 TEL. (212) 397-0606

JOB NAME/LOC.: EMBASSY SQUARE SUITES WA, DC (AMTECH)		
DATE: 04/12/96	CEC JOB NO. 2989	CAR NO. 1 THRU 4
DRAWN BY: CAD	DWG. NO. 190CTGCM	REV.

06/05/96 08:55 E:\JOBS\2900\2989\190CTGCM.DWG